

## 《混凝土結構作業守則 2013 年》

屋宇署已成立技術委員會，其工作包括向建築業界收集有關使用《混凝土結構作業守則 2013 年》（《混凝土守則 2013》）的意見及回應，並加以考慮。於 2017 年 6 月 13 日和 2020 年 11 月 24 日透過通告函件頒布的修訂，已納入現行的《混凝土守則 2013》（2020 年修訂版）。屋宇署因應技術委員會的建議，公布以下對《混凝土守則 2013》（2020 年修訂版）的修訂，並已上載於屋宇署網站（[www.bd.gov.hk](http://www.bd.gov.hk)）：

- (a) 附錄 A<sup>1</sup>— 2022 年 2 月；
- (b) 附錄 B<sup>1</sup>— 2023 年 6 月；及
- (c) 附錄 C<sup>1</sup>— 2024 年 4 月。

建築事務監督 余寶美

檔 號：BD GR/1-50/76

本作業備考前稱《認可人士及註冊結構工程師作業備考》296  
初 版：2007年6月  
上 次 修 訂 版：2023年6月  
本 修 訂 版：2024年4月（助理署長／拓展(2)）  
（修改第1段及加入附錄 C）

<sup>1</sup> 暫只提供英文版本。

**Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition)**  
**( February 2022 )**

Legends:

 Amended

 Deleted

(6/2023)

Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition) in February 2022 included:

- (a) clause 6.2.3 and Figure 6.18b – addition of design requirements for plain concrete linings;
- (b) clause 10.3.4.2 and Table 10.2 – revision of the requirements on the use of 100 mm and 150 mm concrete cubes;
- (c) clause 11.7.5.4 and Table 11.2 – addition of general guidelines on monitoring early compressive strength of insitu concrete by maturity method; and
- (d) Annex A – addition of ASTM C1074-19<sup>e1</sup> corresponding to the new clause 11.7.5.4.

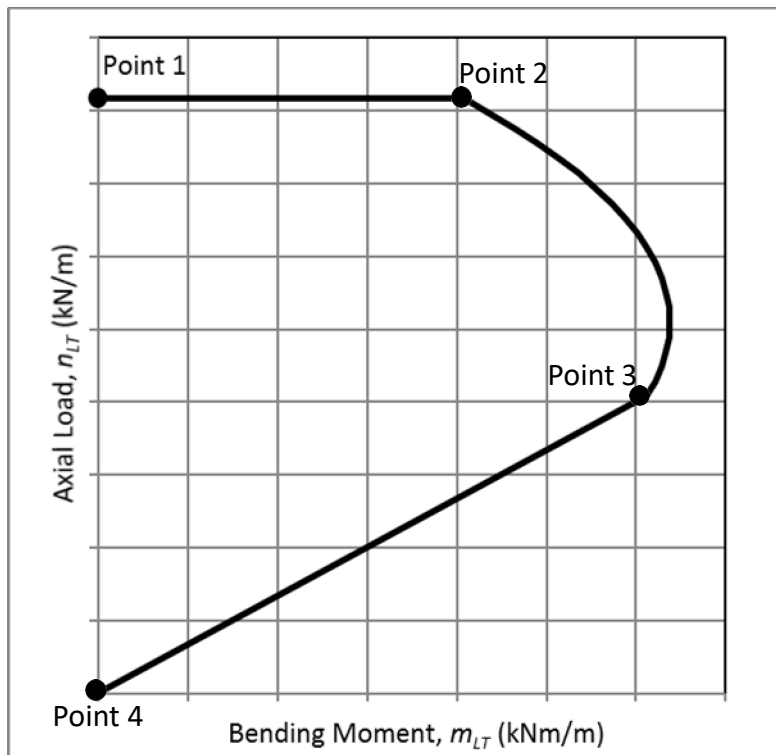
### Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition)

Item	Current version	Amendments
1. Contents	6.2.2 Walls	6.2.2 Walls <b>6.2.3 Plain concrete linings</b>
2. LIST OF TABLES <sup>1</sup>	Table 11.1 – Objects of production and construction control Table 12.1 – Design flexural tensile stresses for class 2 members: serviceability limit state: cracking	Table 11.1 – Objects of production and construction control <b>Table 11.2 – Correction factor applied to the estimated insitu concrete compressive strength</b> Table 12.1 – Design flexural tensile stresses for class 2 members: serviceability limit state: cracking
3. LIST OF FIGURES <sup>2</sup>	Figure 6.18a - Geometry of the Circular Section Figure 6.19 - Critical section for shear check in a pile cap	Figure 6.18a - Geometry of the Circular Section <b>Figure 6.18b - Interaction Curve for Design of Plain Concrete Lining</b> Figure 6.19 - Critical section for shear check in a pile cap
4. Clause 6.2.3 and Figure 6.18b	-	<b>6.2.3 Plain concrete linings</b> <b>6.2.3.1 General</b> Plain concrete is suitable for use in structural members with high axial loads and relatively low bending moments. The following criteria can generally be applied to the use of plain concrete lining in tunnels or caverns: (a) the lining curvature is adequate to accommodate axial distribution of external loads; (b) the plain concrete lining is constructed in relatively good rock geology and is always in compression under all load combinations; (c) the effect of imperfection of the concrete lining has been considered by means of rigorous structural analysis of the plain concrete lining; and

<sup>1</sup> Addition of Table 11.2 corresponding to the new clause 11.7.5.4.

<sup>2</sup> Addition of Figure 6.18b corresponding to the new clause 6.2.3.

Item	Current version	Amendments
		<p>(d) an arch section can be formed by plain concrete in conjunction with a reinforced concrete invert provided the junction between the plain and reinforced concrete satisfies the design requirements specified in clause 6.2.3.2.</p> <p>6.2.3.2 <i>Design of plain concrete lining</i></p> <p>(a) Maximum axial load for plain concrete lining</p> <p>The design ultimate capacity of axial load per unit length, <math>n_{LT}</math> and design maximum ultimate bending moment per unit length, <math>m_{LT}</math> (<math>=n_{LT} e_x</math>) shall be evaluated using the interaction curve as shown in Figure 6.18b.</p> <p>(i) The first section (Point 1 to Point 2) of the interaction curve as shown in Figure 6.18b, the highest axial force, is applicable when the eccentricity of the thrust force is less than or equal to <math>0.1h</math>. The ultimate capacity is calculated using a rectangular stress block over the whole section;</p> <p>For <math>e_x \leq 0.1h</math></p> $n_{LT} \leq 0.32h f_{cu} \quad 6.63a$ <p>(ii) The second section (Point 2 to Point 3) of the interaction diagram is based on a rectangular stress block approach and is applicable for eccentricity between <math>0.1h</math> and <math>0.3h</math>. The stress block is acting over part of the section, and reduces as the eccentricity increases.</p> <p>For <math>0.1h &lt; e_x \leq 0.3h</math></p> $n_{LT} \leq 0.4 (h - 2 e_x) f_{cu} \quad 6.63b$ <p>where:</p>

Item	Current version	Amendments
		<p data-bbox="1411 215 2078 303"><math>e_x</math> is the resultant eccentricity of load at right angles to the plan of the lining.</p> <p data-bbox="1321 335 2078 534">(iii) Cracking restriction limits the use of the strength design method to a maximum eccentricity of <math>0.3h</math>. The third section (Point 3 to Point 4) of the interaction curve is a straight line down to the point <math>n_{LT} = 0</math>, <math>m_{LT} = 0</math>, as shown in Figure 6.18b.</p> <div data-bbox="1299 590 2072 1348">  </div> <p data-bbox="1332 1356 2078 1428"><b>Figure 6.18b – Interaction Curve for Design of Plain Concrete Lining</b></p>

Item	Current version	Amendments
		<p>(b) Shear strength The design shear stress in the plain concrete lining subjected to shear and axial compression without shear reinforcement can be calculated in accordance with clause 6.1.2.5(k).</p> <p>The design shear resistance of plain concrete lining can be checked in accordance with clause 6.2.2.3(r).</p>
5. Clause 10.3.4.2(a)	<p>10.3.4.2 Concrete Cube Tests During Construction</p> <p>(a) Concrete Cubes</p> <p>The compressive strength of concrete shall be determined by testing 100 mm or 150 mm cubes 28 days after mixing. A representative sample shall be taken from fresh concrete to make test cubes and each sample shall be taken from a single batch. The rate of sampling shall be at least that specified in Table 10.1 and at least one sample shall be taken from each grade of concrete produced on any one day.</p>	<p>10.3.4.2 Concrete Cube Tests During Construction</p> <p>(a) Concrete Cubes</p> <p>The compressive strength of concrete shall be determined by testing 100 mm cubes, or 150 mm cubes if the maximum aggregate size of concrete exceeds 20 mm, 28 days after mixing. A representative sample shall be taken from fresh concrete to make test cubes and each sample shall be taken from a single batch. The rate of sampling shall be at least that specified in Table 10.1 and at least one sample shall be taken from each grade of concrete produced on any one day.</p>

Item	Current version	Amendments																																																			
6. Table 10.2	<table border="1" data-bbox="392 268 1173 676"> <thead> <tr> <th rowspan="3">Specified Grade Strength</th> <th rowspan="3">Compliance Criteria</th> <th colspan="2">Column A</th> <th colspan="2">Column B</th> </tr> <tr> <th colspan="2">Average of 4 consecutive test results shall exceed the specified grade strength by at least</th> <th colspan="2">Any individual test result shall not be less than the specified grade strength minus</th> </tr> <tr> <th>150 mm Cubes</th> <th>100 mm Cubes</th> <th>150 mm Cubes</th> <th>100 mm Cubes</th> </tr> </thead> <tbody> <tr> <td rowspan="2">C20 and above</td> <td>C1</td> <td>5 MPa</td> <td>7 MPa</td> <td>3 MPa</td> <td>2 MPa</td> </tr> <tr> <td>C2</td> <td>3 MPa</td> <td>5 MPa</td> <td>3 MPa</td> <td>2 MPa</td> </tr> <tr> <td>Below C20</td> <td>C1 or C2</td> <td>2 MPa</td> <td>3 MPa</td> <td>2 MPa</td> <td>2 MPa</td> </tr> </tbody> </table> <p data-bbox="392 687 1111 719">Table 10.2 - Compressive Strength Compliance Criteria</p>	Specified Grade Strength	Compliance Criteria	Column A		Column B		Average of 4 consecutive test results shall exceed the specified grade strength by at least		Any individual test result shall not be less than the specified grade strength minus		150 mm Cubes	100 mm Cubes	150 mm Cubes	100 mm Cubes	C20 and above	C1	5 MPa	7 MPa	3 MPa	2 MPa	C2	3 MPa	5 MPa	3 MPa	2 MPa	Below C20	C1 or C2	2 MPa	3 MPa	2 MPa	2 MPa	<table border="1" data-bbox="1198 268 2056 724"> <thead> <tr> <th rowspan="3">Specified Grade Strength</th> <th rowspan="3">Compliance Criteria</th> <th colspan="1">Column A</th> <th colspan="1">Column B</th> </tr> <tr> <th colspan="2">Average of 4 consecutive test results shall exceed the specified grade strength by at least</th> <th colspan="1">Any individual test result shall not be less than the specified grade strength minus</th> </tr> <tr> <th colspan="1">100 mm Cubes (150 mm Cubes)</th> <th colspan="1">100 mm Cubes (150 mm Cubes)</th> </tr> </thead> <tbody> <tr> <td rowspan="2">C20 and above</td> <td>C1</td> <td>7 MPa (5 MPa)</td> <td>2 MPa (3 MPa)</td> </tr> <tr> <td>C2</td> <td>5 MPa (3 MPa)</td> <td>2 MPa (3 MPa)</td> </tr> <tr> <td>Below C20</td> <td>C1 or C2</td> <td>3 MPa (2 MPa)</td> <td>2 MPa (2 MPa)</td> </tr> </tbody> </table> <p data-bbox="1198 735 1917 767">Table 10.2 - Compressive Strength Compliance Criteria</p>	Specified Grade Strength	Compliance Criteria	Column A	Column B	Average of 4 consecutive test results shall exceed the specified grade strength by at least		Any individual test result shall not be less than the specified grade strength minus	100 mm Cubes (150 mm Cubes)	100 mm Cubes (150 mm Cubes)	C20 and above	C1	7 MPa (5 MPa)	2 MPa (3 MPa)	C2	5 MPa (3 MPa)	2 MPa (3 MPa)	Below C20	C1 or C2	3 MPa (2 MPa)	2 MPa (2 MPa)
Specified Grade Strength	Compliance Criteria			Column A		Column B																																															
				Average of 4 consecutive test results shall exceed the specified grade strength by at least		Any individual test result shall not be less than the specified grade strength minus																																															
		150 mm Cubes	100 mm Cubes	150 mm Cubes	100 mm Cubes																																																
C20 and above	C1	5 MPa	7 MPa	3 MPa	2 MPa																																																
	C2	3 MPa	5 MPa	3 MPa	2 MPa																																																
Below C20	C1 or C2	2 MPa	3 MPa	2 MPa	2 MPa																																																
Specified Grade Strength	Compliance Criteria	Column A	Column B																																																		
		Average of 4 consecutive test results shall exceed the specified grade strength by at least		Any individual test result shall not be less than the specified grade strength minus																																																	
		100 mm Cubes (150 mm Cubes)	100 mm Cubes (150 mm Cubes)																																																		
C20 and above	C1	7 MPa (5 MPa)	2 MPa (3 MPa)																																																		
	C2	5 MPa (3 MPa)	2 MPa (3 MPa)																																																		
Below C20	C1 or C2	3 MPa (2 MPa)	2 MPa (2 MPa)																																																		
7. Clause 10.3.4.2(b) (i)	<p data-bbox="392 799 1173 1091">(i) Before 40 test results are available, where there is sufficient previous production data using similar materials from the same plant under similar supervision to establish that the standard deviation of 40 test results is less than 5 MPa for 150 mm test cubes or 5.5 MPa for 100 mm test cubes, compliance requirement C2 may be adopted; otherwise compliance requirement C1 shall be adopted.</p>	<p data-bbox="1198 799 2065 1018">(i) Before 40 test results are available, where there is sufficient previous production data using similar materials from the same plant under similar supervision to establish that the standard deviation of 40 test results is less than 5.5 MPa (5 MPa for 150 mm cubes), compliance requirement C2 may be adopted; otherwise compliance requirement C1 shall be adopted.</p>																																																			
8. Clause 10.3.4.2(b) (ii)	<p data-bbox="392 1139 1173 1390">(ii) Where the calculated standard deviation of a set of 40 consecutive test results of concrete judged by compliance requirement C2 of Table 10.2 exceeds 5 MPa for 150 mm test cubes or 5.5 MPa for 100 mm test cubes, compliance requirement for checking the test results shall be changed from C2 to C1 on the 35<sup>th</sup> day after making the last pair of test cubes in the set of 40.</p>	<p data-bbox="1198 1139 2065 1353">(ii) Where the calculated standard deviation of a set of 40 consecutive test results of concrete judged by compliance requirement C2 of Table 10.2 exceeds 5.5 MPa (5 MPa for 150 mm cubes), compliance requirement for checking the test results shall be changed from C2 to C1 on the 35<sup>th</sup> day after making the last pair of test cubes in the set of 40.</p>																																																			



Item	Current version	Amendments
9. Clause 10.3.4.2(b) (iii)	(iii) Where the calculated standard deviation of 40 previous consecutive test results is less than 5 MPa for 150 mm test cubes or 5.5 MPa for 100 mm test cubes, compliance requirement shall be changed from C1 to C2 on the 35 <sup>th</sup> day after making the last pair of test cubes in the set of 40.	(iii) Where the calculated standard deviation of 40 previous consecutive test results is less than <del>5.5 MPa</del> (5 MPa for 150 mm cubes), compliance requirement shall be changed from C1 to C2 on the 35 <sup>th</sup> day after making the last pair of test cubes in the set of 40.
10. Clause 10.3.4.2(b) (iv)	(iv) For concrete grade not exceeding C60, the calculated standard deviation exceeds 8 MPa for 150 mm test cubes or 8.5 MPa for 100 mm test cubes; or	(iv) For concrete grade not exceeding C60, the calculated standard deviation exceeds <del>8.5 MPa</del> (8 MPa for 150 mm cubes); or
11. Clause 10.3.4.2(b) (vi)	(vi) The average of the latest 40 cube test results exceeds the grade strength by at least 10 MPa for 150 mm test cubes or 12 MPa for 100 mm test cubes and all individual test results exceeds the grade strength by at least 4 MPa for 150 mm test cubes or 5 MPa for 100 mm test cubes; or	(vi) The average of the latest 40 cube test results exceeds the grade strength by at least <del>12 MPa</del> (10 MPa for 150 mm cubes) and all individual test results exceeds the grade strength by at least <del>5 MPa</del> (4 MPa for 150 mm cubes); or
12. Clause 11.7.5.4 and Table 11.2	-	<p><i>11.7.5.4 Monitoring early compressive strength of insitu concrete by maturity method</i></p> <p>After concrete casting, the development of insitu concrete compressive strength at early age can be monitored by the maturity method. The maturity method can be used for estimating insitu concrete compressive strength through measurement of the temperature-time history of concrete of ages up to 14 days after casting, for the purpose of determining the concrete strength for striking of formwork and falsework<sup>1</sup> in lieu of the minimum periods specified in clause 10.3.8.2. In formulating a proposal adopting the maturity method, reference should be made to the acceptable standard in Annex A. The proposal should cover the following:</p>

Item	Current version	Amendments									
		<p>(a) choice of an appropriate maturity function and determination of maturity function constants;</p> <p>(b) apparatuses and their calibration;</p> <p>(c) procedure for developing strength-maturity relationship;</p> <p>(d) procedure for estimating insitu concrete strength;</p> <p>(e) validation of insitu concrete strength;</p> <p>(f) re-calibration and re-validation; and</p> <p>(g) quality assurance and supervision.</p> <p>The concrete mix used in the structure should be the same as that used to derive the strength-maturity relationship.</p> <p>Taking into account the different conditions between cast insitu concrete and concrete cubes under various curing temperatures in the calibration process, a correction factor as shown in Table 11.2 should be applied to the estimated insitu concrete compressive strength.</p> <table border="1" data-bbox="1205 997 2040 1348"> <thead> <tr> <th data-bbox="1214 1003 1563 1177">Type of concrete mix</th> <th data-bbox="1570 1003 1809 1177">≤ 48 hours after concrete casting</th> <th data-bbox="1816 1003 2031 1177">&gt; 48 hours after concrete casting</th> </tr> </thead> <tbody> <tr> <td data-bbox="1214 1182 1563 1278">Concrete mix containing pfa or ggbs</td> <td data-bbox="1570 1182 1809 1278">0.7</td> <td data-bbox="1816 1182 2031 1278">0.8</td> </tr> <tr> <td data-bbox="1214 1283 1563 1342">Other concrete mix</td> <td data-bbox="1570 1283 1809 1342">0.8</td> <td data-bbox="1816 1283 2031 1342">0.8</td> </tr> </tbody> </table> <p><b>Table 11.2 – Correction factor applied to the estimated insitu concrete compressive strength</b></p>	Type of concrete mix	≤ 48 hours after concrete casting	> 48 hours after concrete casting	Concrete mix containing pfa or ggbs	0.7	0.8	Other concrete mix	0.8	0.8
Type of concrete mix	≤ 48 hours after concrete casting	> 48 hours after concrete casting									
Concrete mix containing pfa or ggbs	0.7	0.8									
Other concrete mix	0.8	0.8									

Item	Current version	Amendments
		1 Due to the rapid rate of concrete strength development within 24 hours after concrete casting, the maturity method is not suitable for use in justifying minimum periods before striking formwork and falsework of less than 24 hours.
13. Annex A <sup>3</sup>	BS EN 13263-1:2005 Silica fume for concrete. Definitions, requirements and conformity criteria +A1:2009	BS EN 13263-1:2005 Silica fume for concrete. Definitions, requirements and conformity criteria  ASTM C1074-19 <sup>e1</sup> Standard Practice for Estimating Concrete Strength by the Maturity Method

<sup>3</sup> Addition of ASTM C1074-19<sup>e1</sup> corresponding to the new clause 11.7.5.4.

**Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition)**  
**( June 2023 )**

Legends:

 Amended  
 Deleted

(6/2023)

Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition) in June 2023 included:

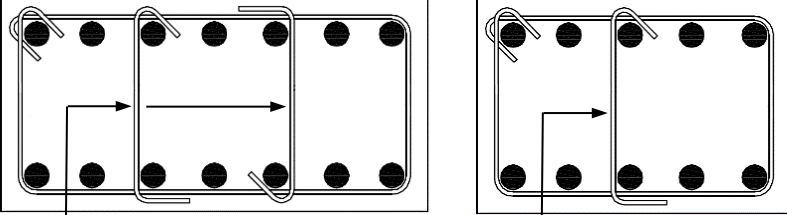
- (a) Clause 3.2.8.3 and Annex A – Addition of referenced standard ISO 15835-2 for the test method on mechanical coupler; and
- (b) Clause 9.9.1.3(b) and Figure 9.6a – Addition of alternative arrangement for links/ties for beam.

## Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition)

Item	Current version	Amendments
1. List of Figures	Figure 9.6 - Typical corbel detailing..... Figure 9.7 - Typical confinement in beam.....	Figure 9.6 - Typical corbel detailing..... <b>Figure 9.6a - Alternative arrangement for links/ties for beam</b> Figure 9.7 - Typical confinement in beam.....
2. Clause 3.2.8.3 <sup>1</sup>	3.2.8.3 Performance of type 1 mechanical couplers Type 1 mechanical coupler satisfying the following criteria may be used as an alternative to tension or compression laps: (a) when a representative gauge length assembly comprising reinforcement of the diameter, grade and profile to be used, and a coupler of the precise type to be used, is tested in tension the permanent elongation after loading to $0.6f_y$ should not exceed 0.1 mm; and .....	3.2.8.3 Performance of type 1 mechanical couplers Type 1 mechanical coupler satisfying the following criteria may be used as an alternative to tension or compression laps: (a) when a representative gauge length assembly comprising reinforcement of the diameter, grade and profile to be used, and a coupler of the precise type to be used, is tested in tension the permanent elongation after loading to $0.6f_y$ should not exceed 0.1 mm; and .....  <b>Reference may be made to clause 5.4, excluding sub-clause 5.4.4, of ISO 15835-2 for the test method.</b>
3. Clause 9.9.1.3(b) <sup>2</sup>	(b) Anchorage Links should be adequately anchored by means of hooks with bend not less than $135^\circ$ in accordance with clause 8.5. Anchorage by means of welded cross bars is not permitted. Where .....	(b) Anchorage Links should be adequately anchored by means of hooks with bend not less than $135^\circ$ in accordance with clause 8.5. <b>Alternatively, links/ties should be adequately anchored by means of hooks bent through an angle of not less than <math>135^\circ</math> at one end and <math>90^\circ</math> at the other end, and should be alternated end for end along the longitudinal bars (see Figure 9.6a).</b> Anchorage by means of welded cross bars is not permitted. Where .....

<sup>1</sup> Addition of referenced standard ISO 15835-2 for the test method on mechanical coupler.

<sup>2</sup> Addition of alternative arrangement for links/ties for beam.

Item	Current version		Amendments	
4. Figure 9.6a			 <p data-bbox="1288 558 1724 630">Links/ties with alternated end for end along the longitudinal bars</p> <p data-bbox="1803 566 1993 598">Single link/tie</p> <p data-bbox="1276 662 2049 694">Figure 9.6a - Alternative arrangement for links/ties for beam</p>	
5. Annex A	AC 133:2008  BS EN 197-1:2011	Acceptance Criteria for Mechanical Connector Systems for Steel Reinforcing Bars  Cement. Composition, specifications and conformity criteria for common cements	AC 133:2008  ISO 15835-2:2018  BS EN 197-1:2011	Acceptance Criteria for Mechanical Connector Systems for Steel Reinforcing Bars  Steels for the reinforcement of concrete – Reinforcement couplers for mechanical splices of bars – Part 2: Test methods  Cement. Composition, specifications and conformity criteria for common cements

**Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition)**  
**( April 2024 )**

Legends:

 Amended

 Deleted

(4/2024)



Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition) in April 2024 included:

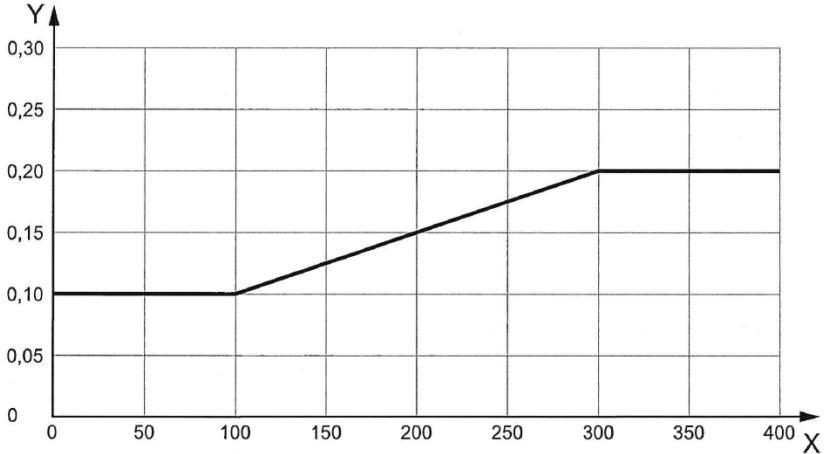
- (a) Clause 3.2.8.3 and Figure 3.9a – addition of maximum allowable permanent elongation for mechanical couplers longer than 100 mm;
- (b) Clauses 6.1.2.1, clause 6.9 and Figures 6.21 to 6.25 – addition of provisions for strut-and-tie system;
- (c) Figure 9.5(g), (h) and (i) – addition of column transverse reinforcement details;
- (d) Clause 11.7.1 – addition of mix proportion for concrete of strength not exceeding 20 N/mm<sup>2</sup> for minor structural and non-structural works and clarification of the limitation on the volume of concrete for exceptional project;
- (e) Equation 12.2 – rectification of typo in equation; and
- (f) Annex A – update of version of standard BS 8500 Parts 1 & 2 and addition of standard BS EN 206:2013.

### Amendments to the Code of Practice for Structural Use of Concrete 2013 (2020 Edition)

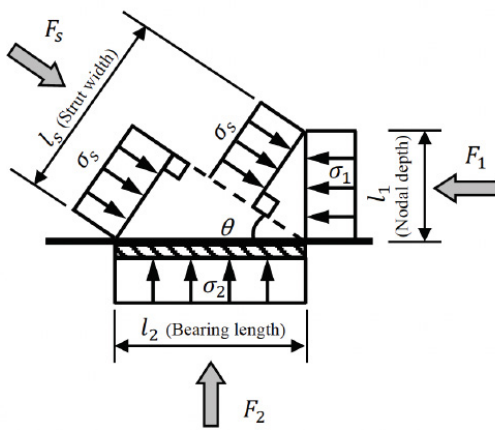
Item	Current version	Amendments
1. Contents	6.8 BEAM-COLUMN JOINTS 6.8.1 General principles and requirements	6.8 BEAM-COLUMN JOINTS 6.8.1 General principles and requirements <b>6.9 STRUT-AND-TIE SYSTEM</b> 6.9.1 General 6.9.2 Modelling and analysis 6.9.3 Design
2. List of Tables	Table 11.1 - Objects of production and construction control Table 11.2 - Correction factor applied to the estimated insitu concrete compressive strength	Table 11.1 - Objects of production and construction control <b>Table 11.1a - Mix proportions for concrete for minor structural and non-structural works</b> Table 11.2 - Correction factor applied to the estimated insitu concrete compressive strength
3. List of Figures	Figure 3.9 - Short-term design stress-strain curve for reinforcement Figure 3.10 - Short-term design stress-strain curve for prestressing tendons	Figure 3.9 - Short-term design stress-strain curve for reinforcement Figure 3.9a - <b>Maximum allowable permanent elongation for type 1 mechanical couplers</b> Figure 3.10 - Short-term design stress-strain curve for prestressing tendons
4. List of Figures	Figure 6.20 - Effective joint widths Figure 7.1 - Assumptions made in calculating curvatures	Figure 6.20 - Effective joint widths <b>Figure 6.21 - Nodal condition</b> <b>Figure 6.22 - Static equilibrium of a strut-and-tie model</b> <b>Figure 6.23 - Load distribution area and loaded area for determining the confinement modification factor</b> <b>Figure 6.24 - Classification of nodes</b> <b>Figure 6.25 - Anchorage of tie reinforcements</b> Figure 7.1 - Assumptions made in calculating curvatures

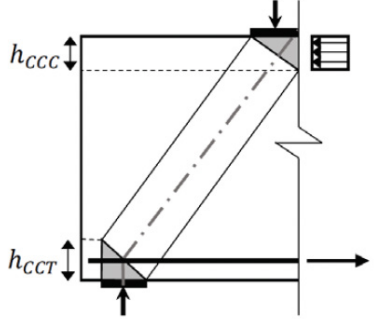
Item	Current version	Amendments
5. Clause 1.5	<p><b>1.5 SYMBOLS</b></p> <p><math>F</math> design ultimate load (e.g. <math>1.4G_k + 1.6Q_k</math>)</p> <p><math>f_{cu}</math> characteristic compressive strength of concrete</p>	<p><b>1.5 SYMBOLS</b></p> <p><math>F</math> design ultimate load (e.g. <math>1.4G_k + 1.6Q_k</math>)</p> <p><math>F_{tie}</math> design resistance of non-prestressed ties</p> <p><math>f_{eb}</math> design ultimate bearing strength based on the weaker of the two bearing surfaces</p> <p><math>f_{ce}</math> design compressive strength of the concrete in a strut or a nodal zone</p> <p><math>f_{cu}</math> characteristic compressive strength of concrete</p>
6. Clause 3.2.8.3 <sup>1</sup>	<p>3.2.8.3 Performance of type 1 mechanical couplers</p> <p>Type 1 mechanical coupler satisfying the following criteria may be used as an alternative to tension or compression laps:</p> <p>(a) when a representative gauge length assembly comprising reinforcement of the diameter, grade and profile to be used, and a coupler of the precise type to be used, is tested in tension the permanent elongation after loading to <math>0.6f_y</math> should not exceed <math>0.1 \text{ mm}^1</math>; and .....</p>	<p>3.2.8.3 Performance of type 1 mechanical couplers</p> <p>Type 1 mechanical coupler satisfying the following criteria may be used as an alternative to tension or compression laps:</p> <p>(a) when a representative gauge length assembly comprising reinforcement of the diameter, grade and profile to be used, and a coupler of the precise type to be used, is tested in tension the permanent elongation after loading to <math>0.6f_y</math> should not exceed <math>0.1 \text{ mm}^1</math>;</p> <p>(b) For couplers longer than 100 mm, the permanent elongation greater than <math>0.1 \text{ mm}</math> may be accepted as per Figure 3.9a subject to crack width control requirements in clauses 7.2.1, 9.4.1 and 12.3.4; and</p> <p>(c) the coupler bar.....</p>

<sup>1</sup> Addition of maximum allowable permanent elongation for mechanical couplers longer than 100 mm.

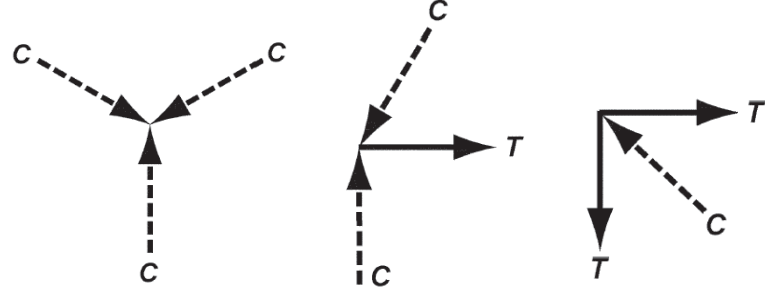
Item	Current version	Amendments
		 <p data-bbox="1232 686 2083 798"> <b>Key</b>  X length of the mechanical coupler, in mm  Y permanent elongation after loading to <math>0.6f_t</math>, in mm </p> <p data-bbox="1276 829 2060 909"> <b>Figure 3.9a – Maximum allowable permanent elongation for type 1 mechanical couplers</b> </p>
7. Clause 6.1.2.1	6.1.2.1 General (a) Design limitations This sub-clause deals with the design of beams of normal proportions. Deep beams (see clause 5.2.1.1(a)) are not considered. For the design of deep beams, reference should be made to specialist literature.	6.1.2.1 General (a) Design limitations This sub-clause deals with the design of beams of normal proportions. Deep beams (see clause 5.2.1.1(a)) are not considered. For the design of deep beams, reference should be made to specialist literature <b>or strut-and-tie system in clause 6.9.</b>
8. Clause 6.9 <sup>2</sup>		<b>6.9 STRUT-AND-TIE SYSTEM</b> <b>6.9.1 General</b> <b>Non-flexural components, e.g. locations near supports and concentrated loads, of reinforced concrete structures can be</b>

<sup>2</sup> Additional of provisions for strut-and-tie system.

Item	Current version	Amendments
		<p>designed using strut-and-tie model. A strut-and-tie model is an idealized pin-jointed truss, comprising concrete compression struts, reinforcement tension ties, and concrete nodes.</p> <p><b>6.9.2 Modelling and analysis</b></p> <p>The angle between the axis of a strut and the axis of a tie (<math>\theta</math>) shall not be less than <math>25^\circ</math> nor exceed <math>60^\circ</math>. The boundary forces and the internal forces can be determined based on the static equilibrium and the truss analysis.</p> <p>The dimensions of nodes shall be determined based on the nodal condition shown in Figure 6.21 by using the static equilibrium corresponding to shear failure and plastic stress state (see Figure 6.22).</p>  <div style="border: 1px solid black; padding: 5px; width: fit-content; margin: 10px auto;"> <math display="block">F_s = \sqrt{F_1^2 + F_2^2}</math> <math display="block">l_s = l_1 \cos \theta + l_2 \sin \theta</math> <math display="block">\sigma_s = F_s / (l_s \times \text{breadth})</math> </div> <p><b>Figure 6.21 – Nodal condition</b></p>

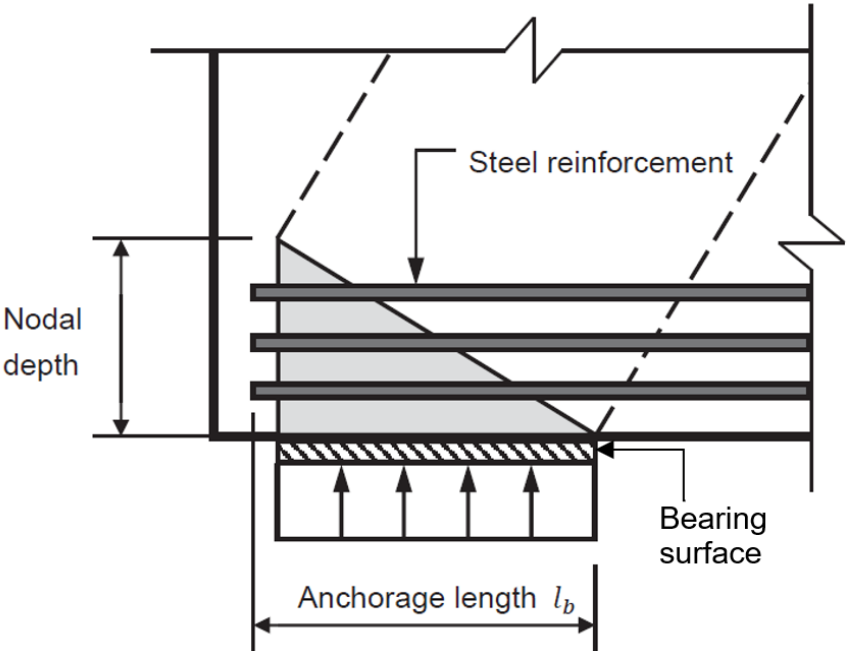
Item	Current version	Amendments
		 <p data-bbox="1303 561 2027 598">Figure 6.22 – Static equilibrium of a strut-and-tie model</p> <p data-bbox="1236 635 1429 671">6.9.3 Design</p> <p data-bbox="1236 676 1809 713">6.9.3.1 Design compressive strength of strut</p> <p data-bbox="1339 715 2094 783">Design compressive strength of concrete in strut <math>f_{cc}</math> should be calculated from:</p> $f_{cc} = 0.32mf_{cu} \quad 6.74$ <p data-bbox="1339 895 1420 932">where</p> <p data-bbox="1370 933 2094 970">m is the confinement modification factor taken as</p> $\sqrt{\frac{A_2}{A_1}} \leq 2,$ <p data-bbox="1370 1048 1637 1085"><math>A_1</math> is loaded area,</p> <p data-bbox="1370 1086 1989 1123"><math>A_2</math> is load distribution area (see Figure 6.23).</p>

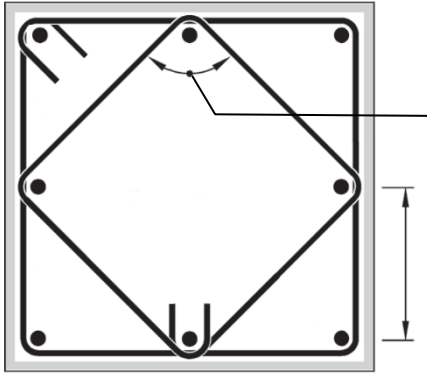
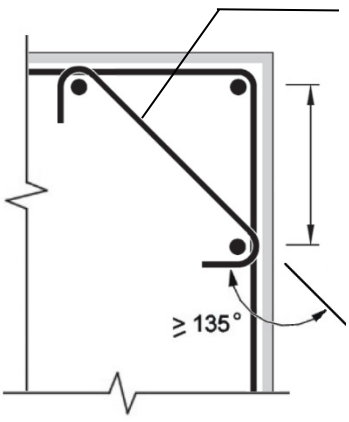
Item	Current version	Amendments									
		<div style="text-align: center;"> </div> <p style="text-align: center;"><b>Plan view</b>                      <b>Side view</b></p> <p style="text-align: center;"><b>Figure 6.23 – Load distribution area and loaded area for determining the confinement modification factor</b></p> <p><b>6.9.3.2 Design compressive strength of nodes</b>  Design compressive strength of concrete at a nodal zone <math>f_{ce}</math> should be calculated as follows:</p> <table style="width: 100%; border: none;"> <tr> <td style="width: 30%;"><math>f_{ce} = 0.45m f_{cu}</math></td> <td style="width: 50%;">for node bounded by struts, bearing areas or both (C-C-C Node)</td> <td style="width: 20%; text-align: right;"><b>6.75</b></td> </tr> <tr> <td><math>f_{ce} = 0.4m f_{cu}</math></td> <td>for node anchoring one tie (C-C-T Node)</td> <td style="text-align: right;"><b>6.76</b></td> </tr> <tr> <td><math>f_{ce} = 0.32m f_{cu}</math></td> <td>for node anchoring two or more tie (C-T-T Node)</td> <td style="text-align: right;"><b>6.77</b></td> </tr> </table> <p style="text-align: center;"><b>Classification of nodes is illustrated in Figure 6.24.</b></p>	$f_{ce} = 0.45m f_{cu}$	for node bounded by struts, bearing areas or both (C-C-C Node)	<b>6.75</b>	$f_{ce} = 0.4m f_{cu}$	for node anchoring one tie (C-C-T Node)	<b>6.76</b>	$f_{ce} = 0.32m f_{cu}$	for node anchoring two or more tie (C-T-T Node)	<b>6.77</b>
$f_{ce} = 0.45m f_{cu}$	for node bounded by struts, bearing areas or both (C-C-C Node)	<b>6.75</b>									
$f_{ce} = 0.4m f_{cu}$	for node anchoring one tie (C-C-T Node)	<b>6.76</b>									
$f_{ce} = 0.32m f_{cu}$	for node anchoring two or more tie (C-T-T Node)	<b>6.77</b>									

Item	Current version	Amendments											
		<div style="text-align: center;">  <p>(i) C-C-C Node      (ii) C-C-T Node      (iii) C-T-T Node</p> <p>Figure 6.24 Classification of nodes</p> <p><b>6.9.3.3 Design compressive strength of bearing</b>  Design ultimate bearing strength based on the weaker of the two bearing surfaces <math>f_{cb}</math> should be calculated as follows:</p> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 20%;"><math>f_{cb} = 0.27mf_{cu}</math></td> <td style="width: 60%;">for dry bearing on concrete</td> <td style="width: 20%; text-align: right;">6.78</td> </tr> <tr> <td><math>f_{cb} = 0.40mf_{cu}</math></td> <td>for bedded bearing on concrete</td> <td style="text-align: right;">6.79</td> </tr> <tr> <td><math>f_{cb} = 0.80mf_{cu}</math></td> <td>for contact face of a steel bearing plate cast into a member or support, with each dimension not exceeding 40% of the corresponding concrete dimension.</td> <td style="text-align: right;">6.80</td> </tr> </table> <p>An intermediate value of bearing stress between dry and bedded bearings may be used for flexible bedding.</p> <p><b>6.9.3.4 Ties</b>  (a) Design resistance of ties  Design resistance of non-prestressed ties shall be calculated as follows:</p> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%;"><math>F_{tie} = 0.87f_y A_s</math></td> <td style="width: 40%; text-align: right;">6.81</td> </tr> </table> </div>	$f_{cb} = 0.27mf_{cu}$	for dry bearing on concrete	6.78	$f_{cb} = 0.40mf_{cu}$	for bedded bearing on concrete	6.79	$f_{cb} = 0.80mf_{cu}$	for contact face of a steel bearing plate cast into a member or support, with each dimension not exceeding 40% of the corresponding concrete dimension.	6.80	$F_{tie} = 0.87f_y A_s$	6.81
$f_{cb} = 0.27mf_{cu}$	for dry bearing on concrete	6.78											
$f_{cb} = 0.40mf_{cu}$	for bedded bearing on concrete	6.79											
$f_{cb} = 0.80mf_{cu}$	for contact face of a steel bearing plate cast into a member or support, with each dimension not exceeding 40% of the corresponding concrete dimension.	6.80											
$F_{tie} = 0.87f_y A_s$	6.81												

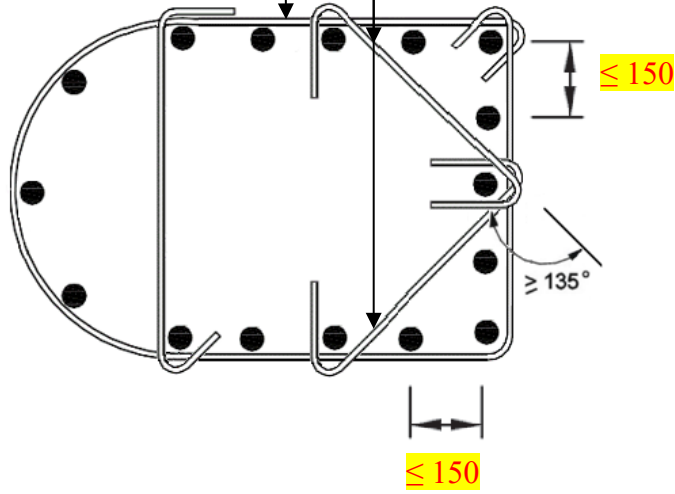


Item	Current version	Amendments
		<p data-bbox="1339 256 1653 292"><b>(b) Arrangement of ties</b></p> <p data-bbox="1395 295 2096 435">The reinforcing bars in a tie shall be evenly distributed across the nodal depth such that the centroid axis of the reinforcing bars coincides with the axis of the tie in the strut-and-tie model.</p> <p data-bbox="1339 480 1626 515"><b>(c) Anchorage of ties</b></p> <p data-bbox="1395 518 2096 770">The reinforcing bars in a tie shall be properly anchored to transfer the tension force into the node through adequate anchorage of longitudinal reinforcement in accordance with clause 8.4. The anchorage begins at the location where the edge of strut meets the bearing surface (see Figure 6.25). For straight bars, they shall be extended beyond the node.</p>

Item	Current version	Amendments
		 <p data-bbox="1366 949 1960 981"><b>Figure 6.25 – Anchorage of tie reinforcements</b></p> <p data-bbox="1232 1021 1646 1053"><b>6.9.3.5 Minimum reinforcement</b></p> <p data-bbox="1332 1061 2094 1173">An orthogonal grid of reinforcing bars shall be placed evenly across each face of the section. The minimum percentage of reinforcement is 0.25%.</p>

Item	Current version	Amendments
9. Figure 9.5 <sup>3</sup>		<div style="text-align: center;">  <p>g)</p> </div> <div style="text-align: center;">  <p>h)</p> </div>

<sup>3</sup> Addition of column transverse reinforcement details.

Item	Current version	Amendments
		<p data-bbox="1245 244 1597 384">Link should be adequately anchored by means of hooks bent through an angle of not less than 135°</p> <p data-bbox="1839 264 2069 371">Link anchored by hooks with bend not less than 135°</p>  <p data-bbox="1234 842 1256 874">i)</p> <p data-bbox="1368 919 1962 951">Figure 9.5 – Column transverse reinforcement</p>
10. Clause 9.9.2.2(c) <sup>4</sup>	(c) Anchorage Links and ties should be adequately anchored by means of hooks with bend not less than 135° in accordance with clause 9.5.2 (see Figure 9.5b, c, d & e). Where .....	(c) Anchorage Links and ties should be adequately anchored by means of hooks with bend not less than 135° in accordance with clause 9.5.2 (see Figure 9.5b, c, d, e, g, h & i). Where .....
11. Clause 11.7.1 <sup>5</sup>	Structural concrete for all works should be obtained from concrete suppliers who are certified under the Quality Scheme for the Production and Supply of Concrete (QSPSC) or similar equivalent, except for those located at remote areas (such as	Structural concrete should be obtained from concrete suppliers who are certified under the Quality Scheme for the Production and Supply of Concrete (QSPSC) or similar equivalent, except for those located at remote areas (such as outlying islands) or where the total

<sup>4</sup> Addition of Figures 9.5(g), (h) and (i)

<sup>5</sup> Addition of mix proportions for concrete of strength not exceeding 20N/mm<sup>2</sup> for minor structural and non-structural works and clarification of the limitation on the volume of concrete for exceptional project.

Item	Current version	Amendments																													
	<p>outlying islands) or where the volume of concrete involved is less than 50 m<sup>3</sup>. Even for these “exceptional” projects, the structural concrete should be obtained from a supplier operating an approved quality system.</p>	<p>volume of concrete <b>per building project</b> involved is less than 50 m<sup>3</sup>. Even for these “exceptional” projects, the structural concrete should be obtained from a supplier operating an approved quality system.</p> <p><b>Concrete with strength not exceeding 20 N/mm<sup>2</sup> may be made using mix proportions, batching by weight, selected from Table 11.1a for minor structural and non-structural works such as on-grade slabs, blinding layer, U-channels/stepped channels, bedding and haunching for pipe works, concrete footings for posts and fences, and mass concrete fill which does not sustain appreciable loading.</b></p> <table border="1" data-bbox="1234 624 2092 1398"> <thead> <tr> <th rowspan="2">Concrete Strength</th> <th rowspan="2">Material</th> <th colspan="2">Weight of aggregate per bag of cement kg</th> <th rowspan="2">Maximum free water/cement ratio</th> </tr> <tr> <th>45 kg bag of cement</th> <th>50 kg bag of cement</th> </tr> </thead> <tbody> <tr> <td rowspan="2">10 N/mm<sup>2</sup></td> <td>Fine aggregate</td> <td>145</td> <td>160</td> <td rowspan="6">0.65</td> </tr> <tr> <td>20 mm coarse aggregate</td> <td>185</td> <td>205</td> </tr> <tr> <td rowspan="2">15 N/mm<sup>2</sup></td> <td>Fine aggregate</td> <td>120</td> <td>130</td> </tr> <tr> <td>20 mm coarse aggregate</td> <td>165</td> <td>180</td> </tr> <tr> <td rowspan="2">20 N/mm<sup>2</sup></td> <td>Fine aggregate</td> <td>95</td> <td>105</td> </tr> <tr> <td>20 mm coarse aggregate</td> <td>145</td> <td>160</td> </tr> </tbody> </table> <p><b>Note: Cement shall be ordinary Portland cement.</b></p>	Concrete Strength	Material	Weight of aggregate per bag of cement kg		Maximum free water/cement ratio	45 kg bag of cement	50 kg bag of cement	10 N/mm <sup>2</sup>	Fine aggregate	145	160	0.65	20 mm coarse aggregate	185	205	15 N/mm <sup>2</sup>	Fine aggregate	120	130	20 mm coarse aggregate	165	180	20 N/mm <sup>2</sup>	Fine aggregate	95	105	20 mm coarse aggregate	145	160
Concrete Strength	Material	Weight of aggregate per bag of cement kg			Maximum free water/cement ratio																										
		45 kg bag of cement	50 kg bag of cement																												
10 N/mm <sup>2</sup>	Fine aggregate	145	160	0.65																											
	20 mm coarse aggregate	185	205																												
15 N/mm <sup>2</sup>	Fine aggregate	120	130																												
	20 mm coarse aggregate	165	180																												
20 N/mm <sup>2</sup>	Fine aggregate	95	105																												
	20 mm coarse aggregate	145	160																												

Item	Current version	Amendments
		<p style="text-align: center;"><b>Table 11.1a – Mix proportions for concrete for minor structural and non-structural works</b></p>
12. Equation 12.2 <sup>6</sup>	$f_{pb} = f_{pe} + \frac{70000\lambda_1}{l/d} \left( 1 - 0.7\lambda_2 \frac{f_{pu}A_{ps}}{f_{cu}bd} \right) \quad 12.2$	$f_{pb} = f_{pe} + \frac{7000\lambda_1}{l/d} \left( 1 - 0.7\lambda_2 \frac{f_{pu}A_{ps}}{f_{cu}bd} \right) \quad 12.2$
13. Annex A	<p>BS 8500-1:2006 Concrete. Complementary British Standard to BS EN 206-1. Method of specifying and guidance for the specifier</p> <p>BS 8500-2:2006 Concrete. Complementary British Standard to BS EN 206-1. Specification for constituent materials and concrete</p>	<p>BS 8500-1:2015 Concrete. Complementary British Standard to BS EN 206-1. Method of specifying and guidance for the specifier</p> <p>BS 8500-2:2015 Concrete. Complementary British Standard to BS EN 206-1. Specification for constituent materials and concrete</p> <p><b>BS EN 206:2013</b> <b>Concrete – Specification, performance, production and conformity</b></p>

<sup>6</sup> Rectification of typo in equation.