


Diagram 1

**Minimum clear width of
the internal corridor serving the “subdivided units”**
(Fire rated door at the original entrance of the flat is maintained)



Legend :

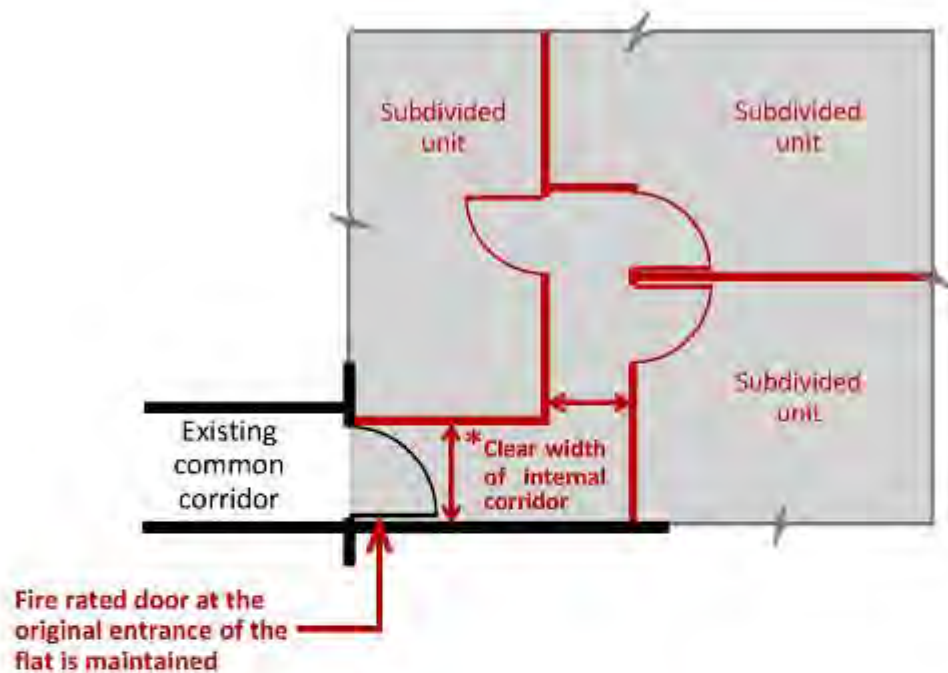

Partition wall and door



The flat as shown on the original approved plan

*** Clear width of internal corridor should be:**

≥ 0.75m if the total number of occupants is not more than 30 persons.

≥ 0.85m if the total number of occupants is more than 30 persons and not more than 200 persons. In addition, at least 2 exit doors each with a minimum width of 0.85m (minimum total width of 1.75m) should be provided and the exit doors should open in the direction of exit.

All the building works are required to meet the requirements of the relevant building regulations and the Code of Practice for Fire Safety in Buildings.